
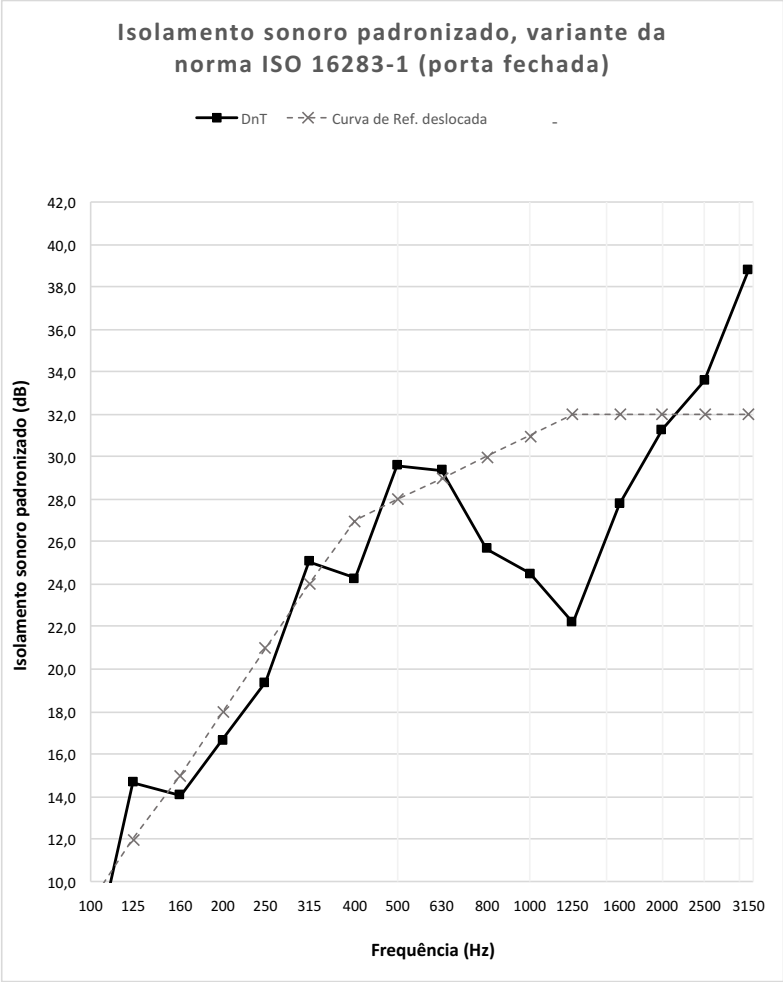


[illegible]

Banda de Frequências (Hz)	Valores de referência (em dB)	Curva de referência ajustada	DnT (em dB)
	Bandas de terços de oitava		
100	33	9,0	5,8
125	36	12,0	14,7
160	39	15,0	14,0
200	42	18,0	16,7
250	45	21,0	19,4
315	48	24,0	25,1
400	51	27,0	24,3
500	52	28,0	29,6
630	53	29,0	29,4
800	54	30,0	25,7
1000	55	31,0	24,5
1250	56	32,0	22,2
1600	56	32,0	27,8
2000	56	32,0	31,3
2500	56	32,0	33,6
3150	56	32,0	38,8


10
10
10
10
10
10
10
10
10
10
10
10
10
10
10
10

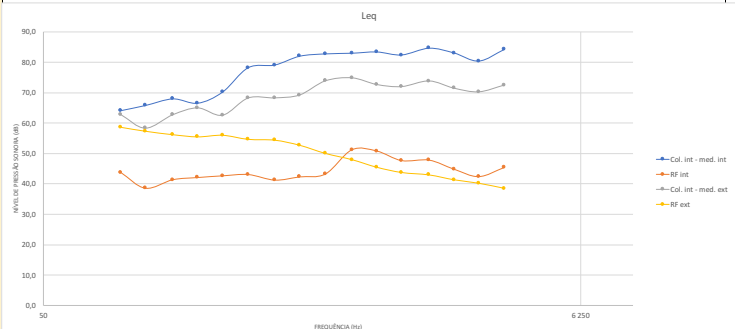

[illegible]

Banda de Frequências (Hz)	Valores de referência (em dB)		Curva de referência ajustada	DnT (em dB)
	Bandas de terços de oitava			
100	33	-4,0		5,4
125	36	-1,0		7,0
160	39	2,0		8,0
200	42	5,0		5,1
250	45	8,0		11,8
315	48	11,0		13,2
400	51	14,0		12,9
500	52	15,0		15,2
630	53	16,0		11,8
800	54	17,0		11,1
1000	55	18,0		13,9
1250	56	19,0		14,0
1600	56	19,0		14,5
2000	56	19,0		15,3
2500	56	19,0		13,6
3150	56	19,0		15,2

-4
-4
-4
-4
-4
-4
-4
-4
-4
-4
-4
-4
-4
-4
-4
-4
-4

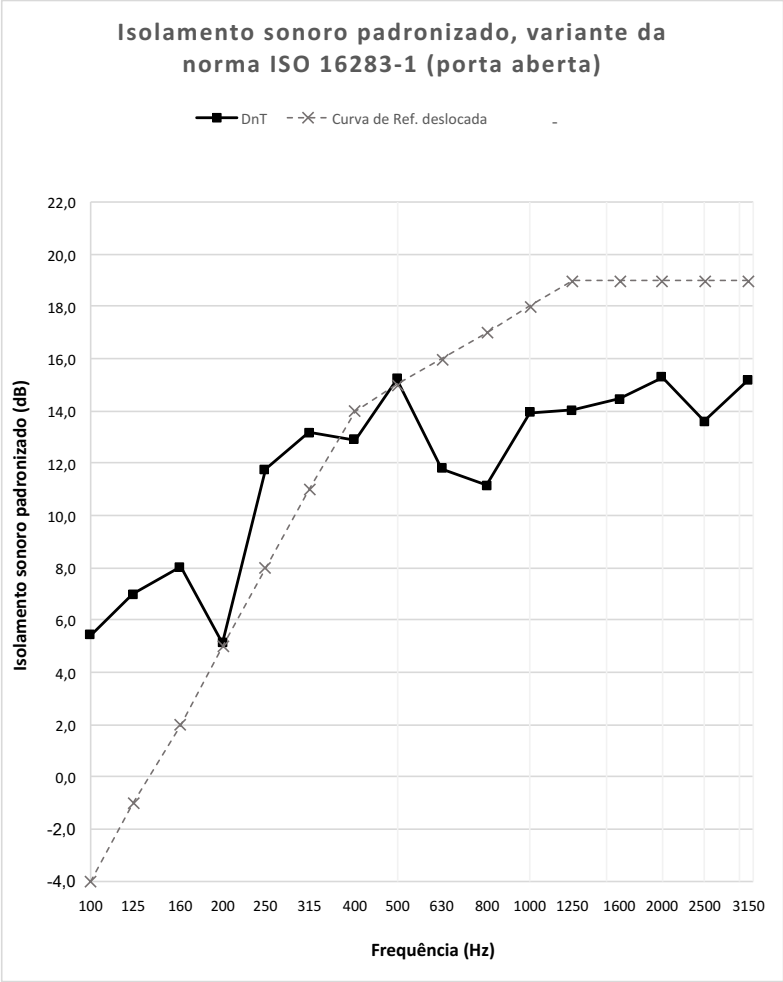

[illegible]


DnT,w	26
-------	----

	sum
--	-----

C=


52

C

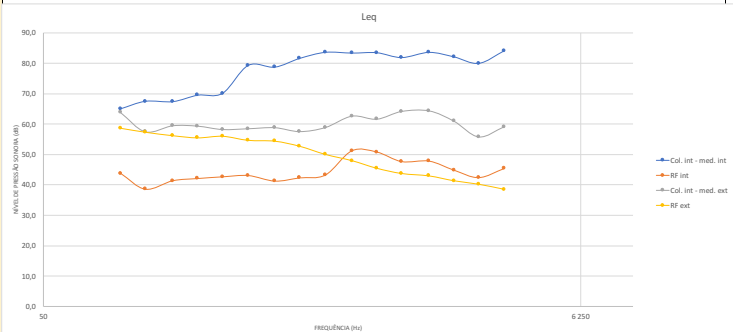


Banda de Frequências (Hz)	Valores de referência (em dB)		Curva de referência ajustada	DnT (em dB)
	Bandas de terços de oitava			
100	33		7,0	4,9
125	36		10,0	11,0
160	39		13,0	12,5
200	42		16,0	15,6
250	45		19,0	19,0
315	48		22,0	26,4
400	51		25,0	24,0
500	52		26,0	28,3
630	53		27,0	28,3
800	54		28,0	23,8
1000	55		29,0	25,1
1250	56		30,0	21,3
1600	56		30,0	23,0
2000	56		30,0	24,9
2500	56		30,0	27,7
3150	56		30,0	28,5

5
5
5
5
5
5
5
5
5
5
5
5
5
5
5
5

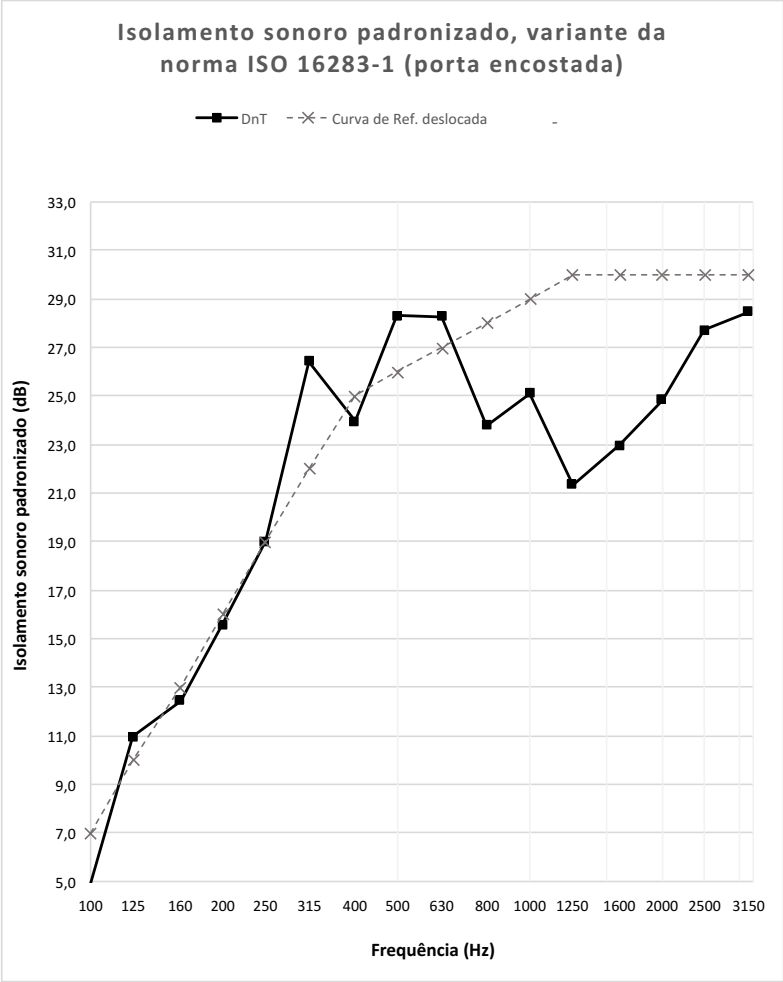

Isolamento sonoro padronizado, segundo a norma ISO 16283-1

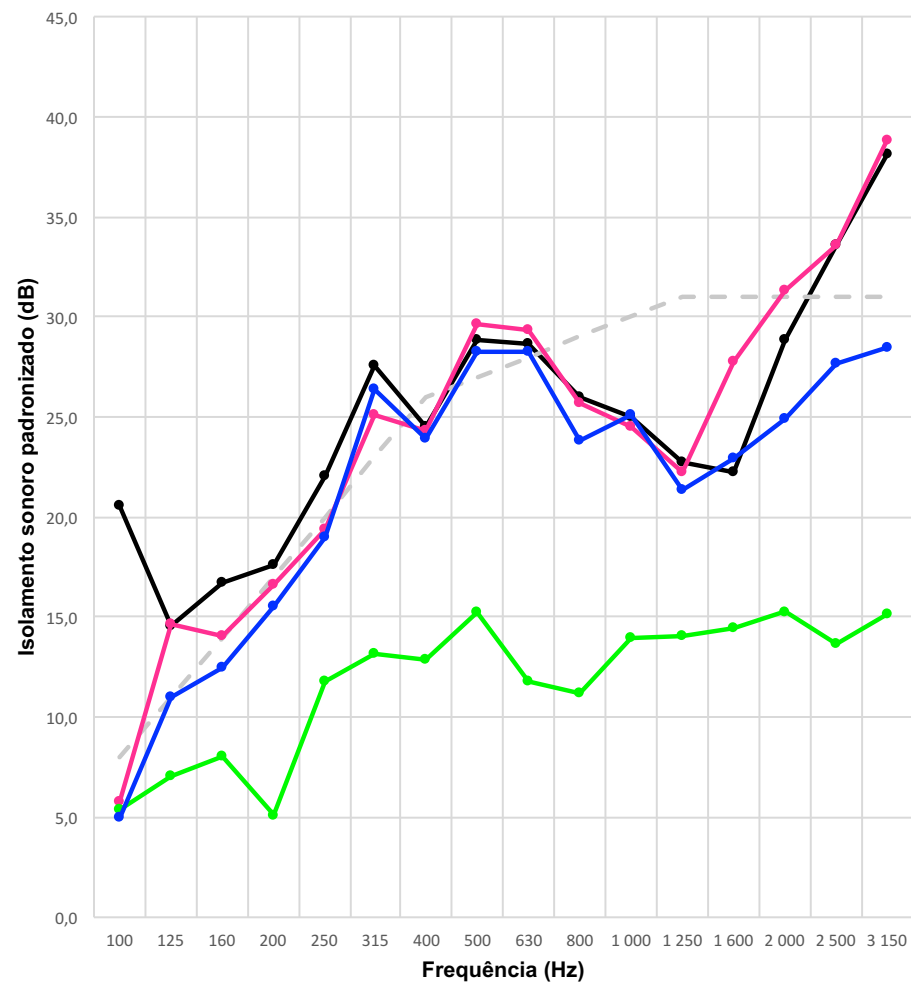

—●— D2m,nT — Curva de referência
—●— Porta fechada (D*2m,nT) —●— Porta aberta (D*2m,nT)
—●— Porta encostada (D*2m,nT)