
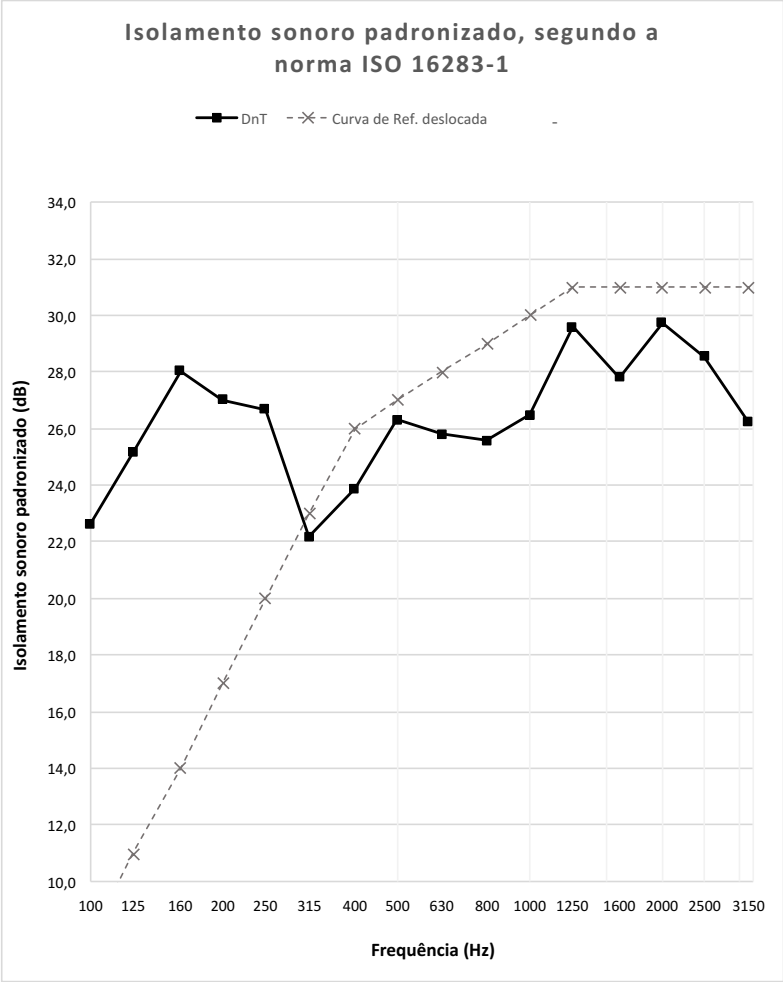



<

Banda de Frequências (Hz)	Valores de referência (em dB)	Curva de referência ajustada	DnT (em dB)
	Bandas de terços de oitava		
100	33	8,0	22,6
125	36	11,0	25,2
160	39	14,0	28,0
200	42	17,0	27,0
250	45	20,0	26,7
315	48	23,0	22,2
400	51	26,0	23,9
500	52	27,0	26,3
630	53	28,0	25,8
800	54	29,0	25,6
1000	55	30,0	26,5
1250	56	31,0	29,6
1600	56	31,0	27,8
2000	56	31,0	29,7
2500	56	31,0	28,5
3150	56	31,0	26,2


10
10
10
10
10
10
10
10
10
10
10
10
10
10
10
10
10
10

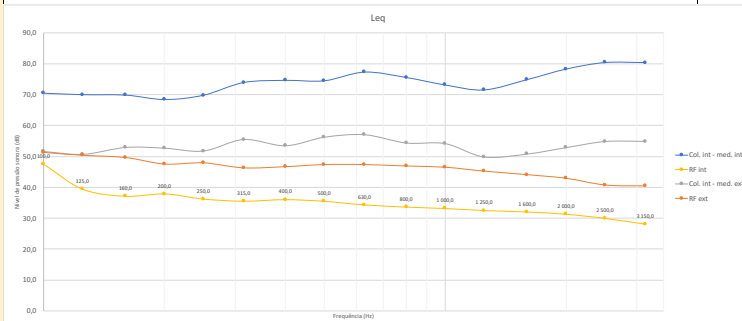

[illegible]

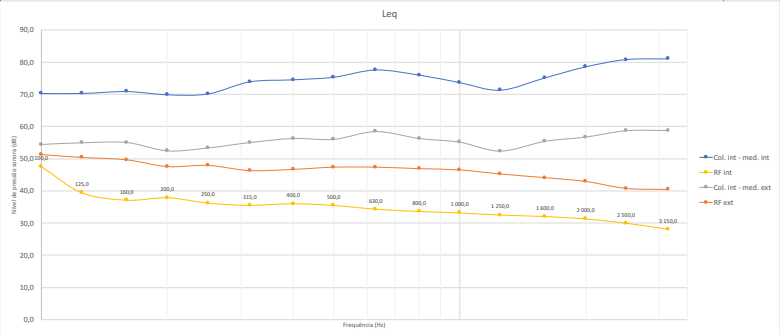
[illegible]

Banda de Frequências (Hz)	Valores de referência (em dB)	Curva de referência ajustada	DnT (em dB)
	Bandas de terços de oitava		
100	33	5,0	19,4
125	36	8,0	18,3
160	39	11,0	19,9
200	42	14,0	21,9
250	45	17,0	21,5
315	48	20,0	22,9
400	51	23,0	22,0
500	52	24,0	23,3
630	53	25,0	22,7
800	54	26,0	23,8
1000	55	27,0	22,6
1250	56	28,0	23,5
1600	56	28,0	23,4
2000	56	28,0	25,8
2500	56	28,0	26,1
3150	56	28,0	26,2

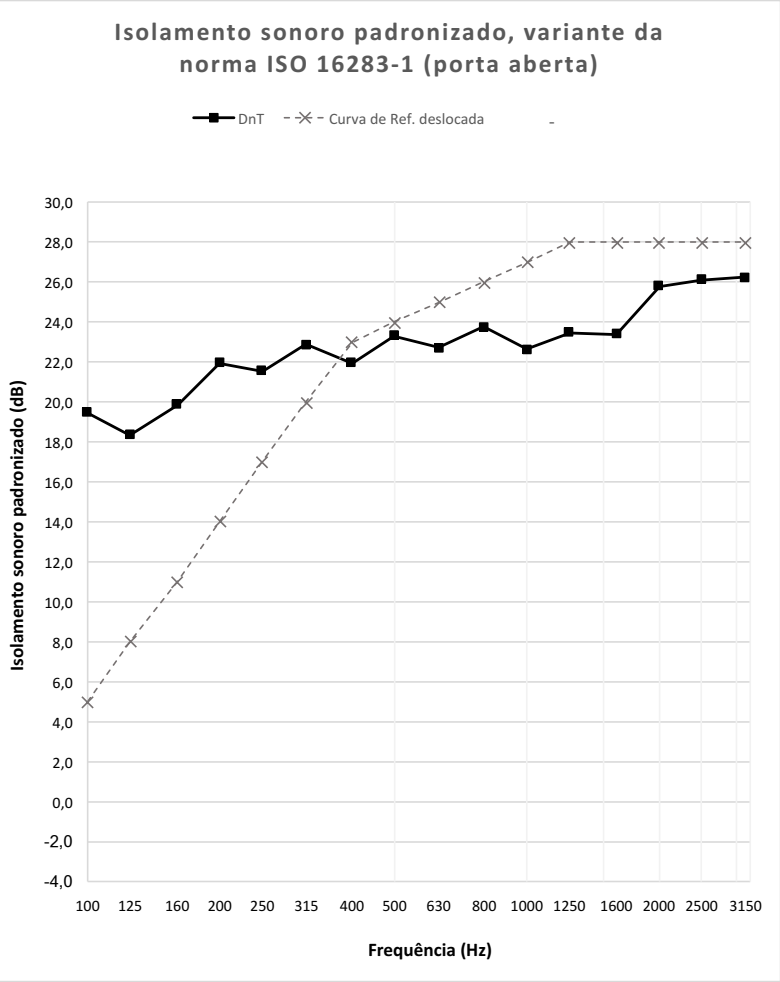


Banda de Frequências (Hz)	Valores de referência (em dB)	Curva de referência ajustada	DnT (em dB)
	Bandas de terços de oitava		
100	33	7,0	19,2
125	36	10,0	23,0
160	39	13,0	24,5
200	42	16,0	24,6
250	45	19,0	23,2
315	48	22,0	20,6
400	51	25,0	22,2
500	52	26,0	22,7
630	53	27,0	25,1
800	54	28,0	25,8
1000	55	29,0	22,4
1250	56	30,0	25,2
1600	56	30,0	27,6
2000	56	30,0	29,0
2500	56	30,0	29,5
3150	56	30,0	29,4

5
5
5
5
5
5
5
5
5
5
5
5
5
5
5
5

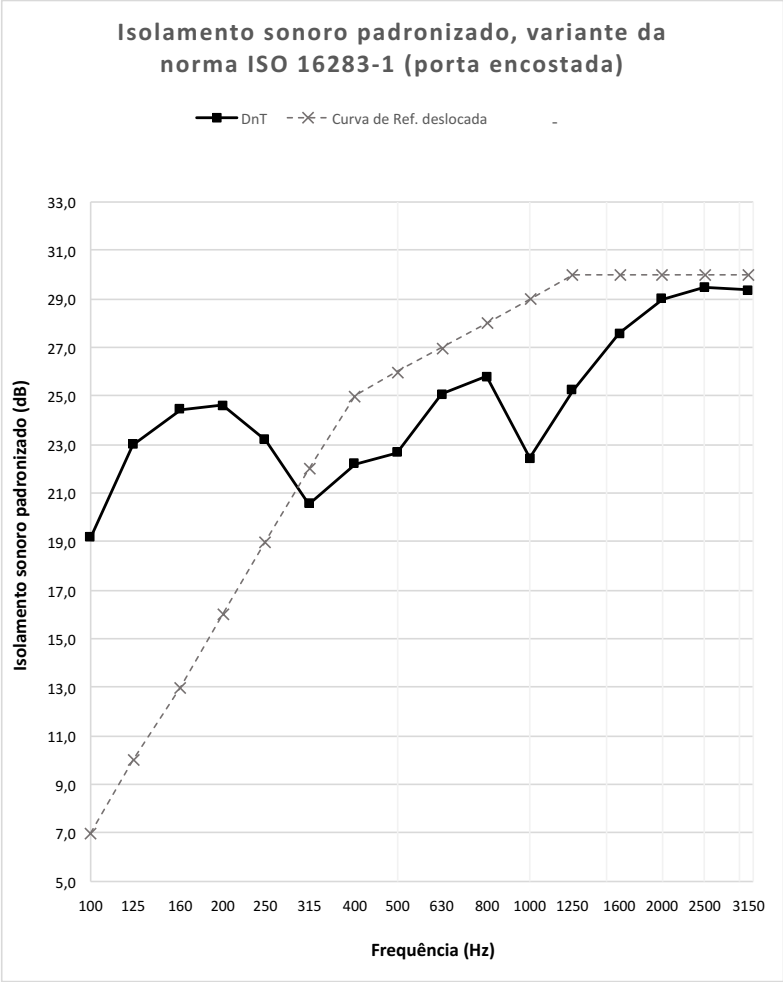

Isolamento sonoro padronizado, segundo a norma ISO 16283-1

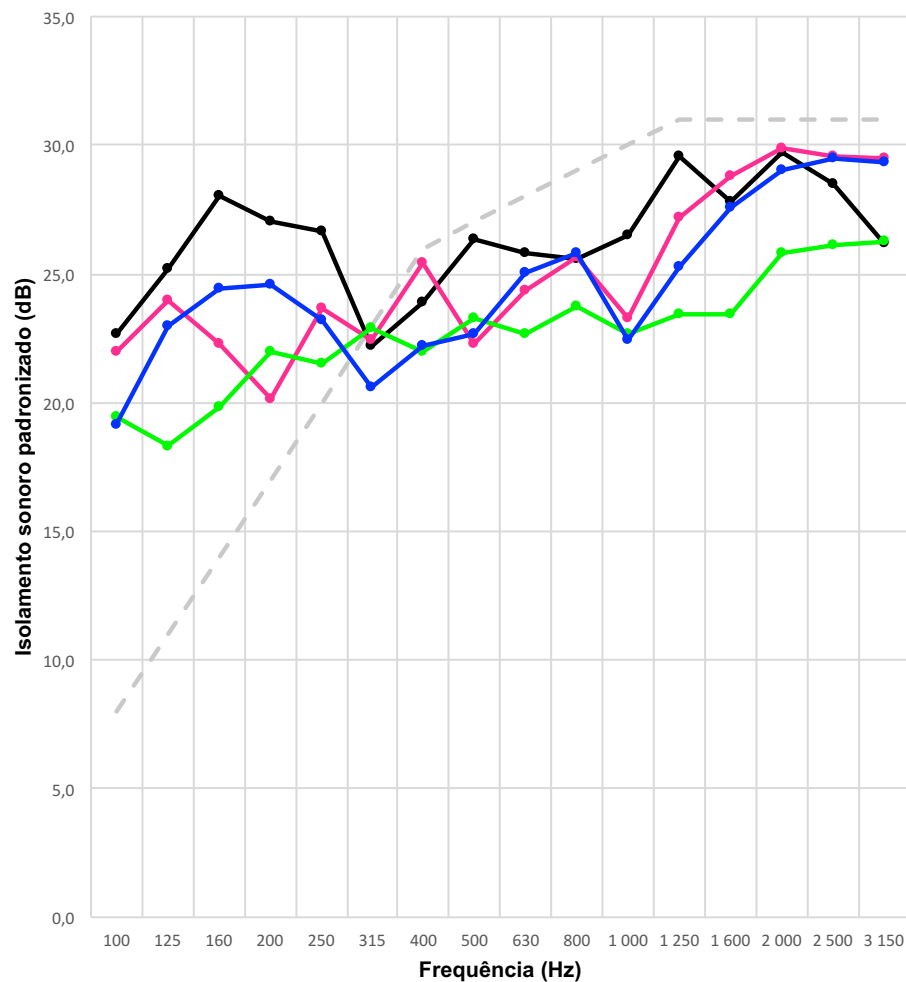

- D2m,nT
- Porta fechada (D*2m,nT)
- Porta encostada (D*2m,nT)
- — Curva de referência
- Porta aberta (D*2m,nT)